

NOTES:

- 1- THIS ROOF FRAMING DESIGN REQUIRES THAT CONTINUOUS 2X CEILING JOISTS BE PROVIDED AND ATTACHED TO EACH RAFTER AT THE TOP PLATE LINE PER DETAIL C SHEET RSD2.0.
- 2- DETAIL IS NOT APPLICABLE TO VAULTED CEILING TYPE OF CONSTRUCTION.



NOTES:

- 1- THIS ROOF FRAMING DESIGN REQUIRES THAT CONTINUOUS 2X CEILING JOISTS BE PROVIDED AND ATTACHED TO EACH RAFTER AT THE TOP PLATE LINE PER DETAIL C SHEET RSD2.0.
- 2- DETAIL IS NOT APPLICABLE TO VAULTED CEILING TYPE OF CONSTRUCTION.



3- BN: BOUNDARY NAILING

EN: EDGE NAILING
SN: SILL PLATE NAILING
FN: FIELD NAILING

FRAMING NOTES:

1- ALL NAILING SHALL BE COMMON NAILS

2 - FRAMING CONNECTORS PER ICBO APPROVED SIMPSON'S MANUFACTURER, OTHER ICBO APPROVED MANUFACTURERS

ARE ALLOWED WITH EQUAL OR LARGER ALLOWABLE LOAD

 \bigwedge shear wall per plans where required

4- NOTCHES & BORED HOLES:

В

C

VERTICAL STUDS			2X4	2X6	2 X 8	2X10	2X12
NOTCHES: BEARING WALLS	25%	w	7/8"	1-3/8"	1-7/8"	2-3/8"	2-7/8"
NON-BEARING WALLS ¹	40%	W	1-3/8"	2-1/4"	2-7/8"	3-3/4"	4-1/2"
BORED HOLES BEARING WALLS ²	40%	w	1-3/8"	2-1/4"	2-7/8"	3-3/4*	4-1/2*
NON-BEARING & DBL. STUDS ³	60%	v	2-1/8"	3-3/8"	4-3/8"	5-5/8"	6-3/4"
HORIZONTAL REPETITIVE MEMBERS ⁴							
NOTCHES— END OF JOISTS	1/4	D ⁸	7/8"	1-3/8"	1-7/8"	2-3/8"	2-7/8"
UP TO 1/3 FROM EITHER ENDS	1/6	D ⁸	5/8"	1"	1-1/4"	1-1/2"	1-7/8"
BORED HOLES	1/3	D ⁸	-	1-1/2"	2-1/2"	3-1/8"	3-3/4"
1							

- NON-BEARING WALLS SUPPORT NO LOADS OTHER THAN THE WEIGHT OF THE PARTITION.
- 2 HOLES CLOSER THAN 5/8" TO EDGE OF STUD ARE CONSIDERED TO BE NOTCHES.
- ONLY TWO CONSECUTIVE BEARING STUDS MAY BE DOUBLED AND BORED TO 60% OF WIDTH.
- 4 REPETITIVE MEMBERS EQUAL 3 OR MORE PARALLEL MEMBERS AT A MAXIMUM OF 24" O.C.
- NOTCHES ONE SIXTH THE DEPTH OF THE JOIST MAY BE IN THE TOP OR BOTTOM EDGE, BUT NEVER IN THE MIDDLE 1/3 OF THE SPAN.
- BORED HOLES ARE NOT PERMITTED WITHIN 2" OF THE TOP OR BOTTOM EDGE OF JOISTS.
- 7 W = WIDTH OF STUD.
- B D = DEPTH OF JOIST OR RAFTER.
- 9 DIAMETER REDUCED DUE TO 2" EDGE REQUIREMENT, SEE FOOTNOTE 6.
- 10 NOTCHES IN BEAMS, POSTS AND CANTILEVERED JOISTS MUST BE SHOWN ON APPROVED PLANS.
- 11 NOTCHES NOT EXCEEDING 1/3 OF THE DEPTH ARE PERWITTED IN THE TOP OF THE RAFTER OR CEILING JOIST NO FURTHER FROM THE FACE OF THE SUPPORT THAN THE DEPTH OF THE MEMBER.


CITY OF INDIO
BUILDING SAFETY DIVISION
ROOF FRAMING
AND
NOTCHING

100 Civic Center Mall Indio, CA 92201 (760) 541-4211



TYPICAL RIDGE CONNECTION

TYPICAL RIDGE CONNECTION

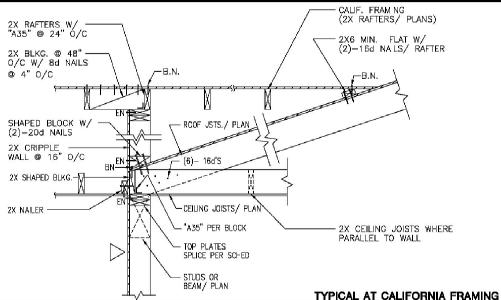

Α

D